


REVISIONS

Ⓐ REVISED MERV RATING, WAS 8
GAC 22MAY2020 - GC 22MAY2020 - SH 22MAY2020

AAF PART NUMBER	NOMINAL SIZE		ACTUAL SIZE		RATED AIRFLOW (CFM)	PLEATS PER LINEAL FOOT	RATED INITIAL RESISTANCE @ 500 FPM (in. W.G.)	RECOMMENDED FINAL RESISTANCE (in. W.G.)	ASHRAE 52.2 MERV	CONTINUOUS OPERATING TEMPERATURE LIMITS		FILTERS PER CARTON
	W	H	W	H						DEG F	DEG C	
148-804-319	12	24	11 3/8	23 3/8	1000	11.0	0.17	1.0	9	200	93	6
148-804-500	16	20	15 3/8	19 3/8	1100							
148-804-600	16	25	15 3/8	24 3/8	1400							
148-804-635	18	24	17 3/8	23 3/8	1500							
148-804-700	20	20	19 3/8	19 3/8	1400							
148-804-800	20	25	19 1/2	24 1/2	1750							
148-804-859	24	20	23 3/8	19 3/8	1650							
148-804-863	24	24	23 3/8	23 3/8	2000							
148-804-868	25	29	24 3/8	28 3/8	2500							

- FRAME:
HIGH WET STRENGTH BEVERAGE BOARD
- MEDIA:
100% SYNTHETIC FIBER UNIFORM MEDIA WITH CONTROLLED FIBER SIZE AND BLEND
- METAL BACKING:
HEAVY-DUTY, GALVANIZED EXPANDED METAL
- ASSEMBLY ADHESIVE:
MOISTURE-RESISTANT
- UL 900 CLASSIFIED
- TOLERANCES:
DEPTH: ±1/16"
HEIGHT AND WIDTH: ±1/8"

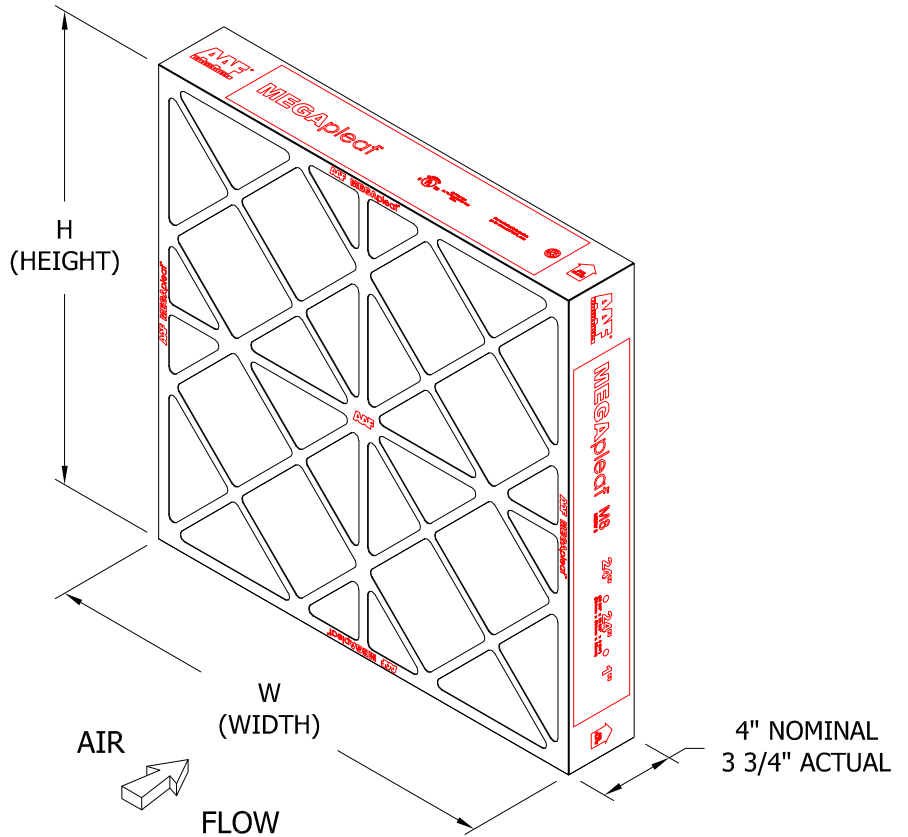

FORM I297 REV. 5/00

DRAWN GAC	DATE 24OCT12	CHECKED GC	DATE 24OCT12	APPR. RDL	DATE 24OCT12	SUPERSEDES
--------------	-----------------	---------------	-----------------	--------------	-----------------	------------



P.O. Box 35690
Louisville, KY.
40232-5690
www.aafintl.com

FILTER ASSEMBLY,
4" MEGApleat M9

DRAWING NO.	REV
3100454	A
SHEET 1	OF 1