

REVISIONS

(A) REVISED IR, WAS 0.62; REVISED DEG °C, WAS 65;
REVISED CLASSIFICATION TO CLASSIFIED
GAC 10DEC14 - GC 10DEC14 - ~~AP~~ 10DEC14

AAF PART NUMBER	NOMINAL SIZE		ACTUAL SIZE		RATED AIRFLOW (CFM)	PLEATS PER LINEAL FOOT	RATED INITIAL RESISTANCE @ 500 FPM (in. W.G.)	RECOMMENDED FINAL RESISTANCE (in. W.G.)	ASHRAE 52.2 MERV	CONTINUOUS OPERATING TEMPERATURE LIMITS		FILTERS PER CARTON
	W	H	W	H						DEG F	DEG C	
173-100-011	10	10	9 1/2	9 1/2	350	15.0	0.42	1.0	8	150	66	12
173-200-011	10	20	9 1/2	19 1/2	700							
173-303-011	12	12	11 1/2	11 1/2	500							
173-314-011	12	20	11 1/2	19 1/2	850							
173-319-011	12	24	11 3/8	23 3/8	1000							
173-371-011	14	20	13 1/2	19 1/2	1000							
173-375-011	14	25	13 1/2	24 1/2	1200							
173-400-011	15	20	14 1/2	19 1/2	1050							
173-448-011	16	16	15 1/2	15 1/2	900							
173-500-011	16	20	15 1/2	19 1/2	1100							
173-600-011	16	25	15 1/2	24 1/2	1400							
173-627-011	18	20	17 1/2	19 1/2	1250							
173-635-011	18	24	17 3/8	23 3/8	1500							
173-631-011	18	25	17 1/2	24 1/2	1550							
173-700-011	20	20	19 1/2	19 1/2	1400							
173-782-011	20	24	19 3/8	23 3/8	1650							
173-800-011	20	25	19 1/2	24 1/2	1750							
173-863-011	24	24	23 3/8	23 3/8	2000							
173-870-011	25	25	24 1/2	24 1/2	2200							

FRAME:

HIGH WET STRENGTH BOARD STOCK WITH SUPPORT STRAPS ON THE AIR ENTERING AND AIR LEAVING SIDE OF FILTER. STRAPS ARE PERPENDICULAR TO PLEATS

MEDIA:


DURAFLEX® 100% SYNTHETIC MEDIA SELF SUPPORTED

TOLERANCES:

DEPTH: ±1/16"

HEIGHT AND WIDTH: ±1/8"

UL 900 CLASSIFIED

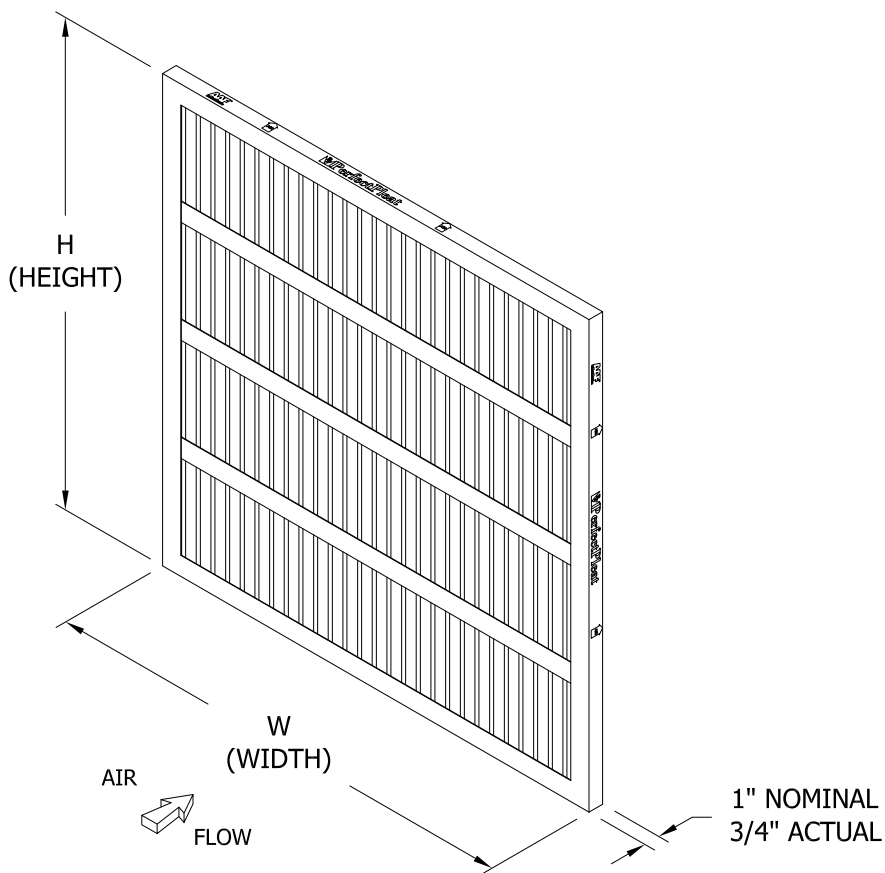

FORM I297 REV 5/00

DRAWN GAC	DATE 24JUN10	CHECKED GC	DATE 5AUG10	APPROVED MAR	DATE 6AUG10	SUPERSEDES 3069929
 PO Box 35690 LOUISVILLE, KY 40223-5000						DRAWING NO. 3069929-A
FILTER ASSEMBLY, 1" PerfectPleat HC M8						