



2820 S. English Station Road - Louisville, KY 40299
 Tel: (502) 357-0132 Fax (502) 267-8379

Date: 25-Jul-07 TEST NO. 07-873Rev1

ASHRAE Standard 52.2-1999 TEST REPORT Initial Efficiency / Resistance

Filter Description

Manufacturer	AAF International
Filter Model	VARICEL
Part Number	331-953-148
Generic Filter Type	Extended Surface Supported
Nominal Dimensions (H x W x D)	24" x 24" x 12"
Pocket / Pleat Quantity	NA
Media Type	Fiberglass
Est. Gross Media Area	105 Ft ²
Adhesive Type	NA



Test Conditions

Loading Dust Type	N A	Test Air Temp (degrees F.)	85
Barometric Pressure (In. Hg.)	29.5	Relative Humidity (%)	39



Test Results

Airflow Rate (CFM)	1968
Nominal Face Velocity (fpm)	492
Initial Resistance (in WG)	0.34
E1 (%) Initial Efficiency 0.30 - 1.0 um	33
E2 (%) Initial Efficiency 1.0 - 3.0 um	74
E3 (%) Initial Efficiency 3.0 - 10.0 um	96
Estimated * Minimum Efficiency Reporting Value (MERV)	MERV 11 @ 1968 CFM
* If initial data is minimum	

Comments Tested For: AAF International

Approval:

Rob B. Bullard

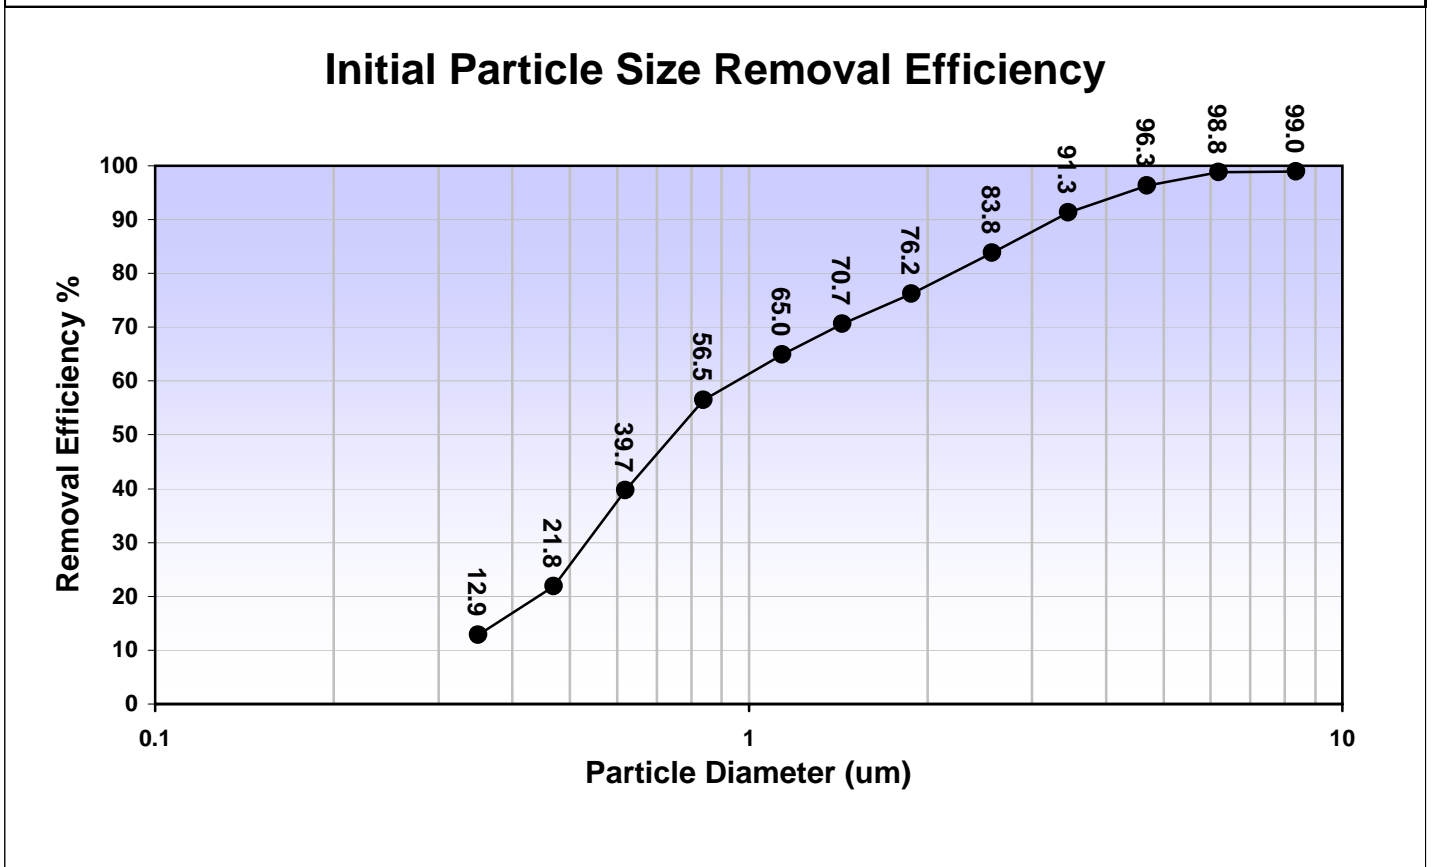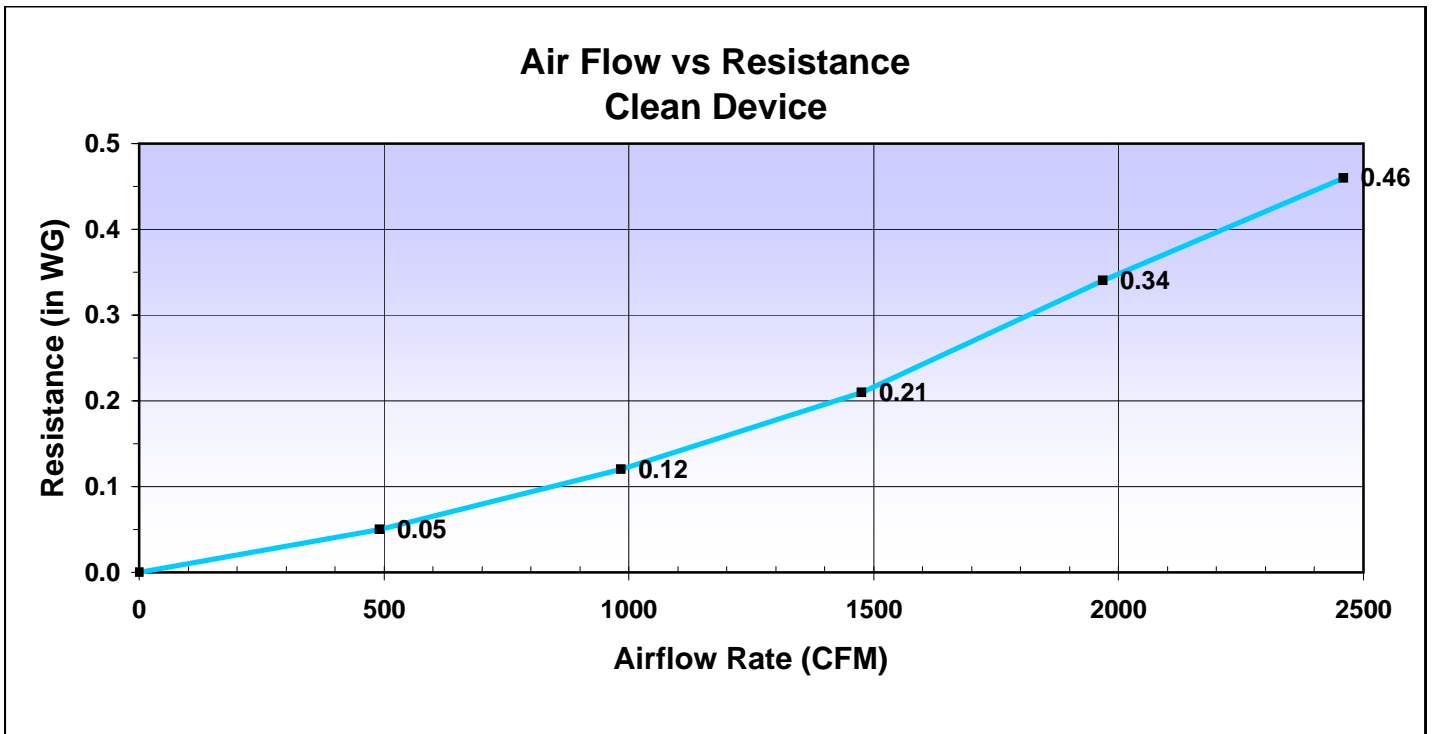

Blue Heaven Technologies

2820 S. ENGLISH STATION ROAD - LOUISVILLE, KY 40299
Tel: (502) 357-0132

ASHRAE Standard 52.2 -1999**Test Report**

Test No. 07-873Rev1

Date: 25-Jul-07

Data - Initial Resistance

Airflow (CFM)	Resistance (in WG)
0	0.00
492	0.05
984	0.12
1476	0.21
1968	0.34
2460	0.46

Data - Particle Removal Efficiency

Particle Size Range (um)	Geometric Mean Diam (um)	Initial Particle Removal Efficiency (%)
0.30 - 0.40	0.35	12.9
0.40 - 0.55	0.47	21.8
0.55 - 0.70	0.62	39.7
0.70 - 1.00	0.84	56.5
1.00 - 1.30	1.14	65.0
1.30 - 1.60	1.44	70.7
1.60 - 2.20	1.88	76.2
2.20 - 3.00	2.57	83.8
3.00 - 4.00	3.46	91.3
4.00 - 5.50	4.69	96.3
5.50 - 7.00	6.20	98.8
7.00 - 10.00	8.37	99.0